



Acoustical Surfaces, Inc.

SOUNDPROOFING, ACOUSTICS, NOISE & VIBRATION CONTROL SPECIALISTS

123 Columbia Court North • Suite 201 • Chaska, MN 55318

(952) 448-5300 • Fax (952) 448-2613 • (800) 448-0121

Email: sales@acousticalsurfaces.com

Visit our Website: www.acousticalsurfaces.com

We Identify and S.T.O.P. Your Noise Problem

SOUTHWEST RESEARCH INSTITUTE®

6220 CULEBRA RD. 78238-5166 • P.O. DRAWER 28510 78228-0510 • SAN ANTONIO, TEXAS, USA • (210) 684-5111 • WWW.SWRI.ORG

CHEMISTRY AND CHEMICAL ENGINEERING DIVISION

FIRE TECHNOLOGY DEPARTMENT

WWW.FIRE.SWRI.ORG

FAX (210) 522-3377



QUALITY SYSTEM
REGISTERED TO
ISO 9001:2000

**INVESTIGATION OF THE SURFACE BURNING
CHARACTERISTICS OF A NOMINAL 1.0-IN.
THICK COTTON ACOUSTICAL SOUND PANEL
(SUPPORTED OVER WIRE AND RODS)
MATERIAL ID: BONDED ACOUSTICAL COTTON
SOUND PANEL (3 LB. WHITE)**

FINAL REPORT

Consisting of 5 Pages

SwRI® Project No.: 01.12693.01.032c

Test Date: October 19, 2006

Report Date: November 13, 2006

Prepared for:

Rendered by Manufacturer and Released to:

Acoustical Surfaces, Inc.

123 Columbia Court North, Suite 201

Chaska, MN 55318

Prepared by:

Anthony L. Saucedo
Senior Engineering Technologist
Material Flammability Section

Approved by:

Gladys M. Miller, M.S., M.B.A.
Assistant Director
Fire Technology Department

This report is for the information of the client. It may be used in its entirety for the purpose of securing product acceptance from duly constituted approval authorities. This report shall not be reproduced except in full, without the written approval of SwRI. Neither this report nor the name of the Institute shall be used in publicity or advertising.



HOUSTON, TEXAS (713) 977-1377 • WASHINGTON, DC (301) 881-0226

- Soundproofing Products • Sonex™ Ceiling & Wall Panels • Sound Control Curtains • Equipment Enclosures • Acoustical Baffles & Banners • Solid Wood & Veneer Acoustical Ceiling & Wall Systems
- Professional Audio Acoustics • Vibration & Damping Control • Fire Retardant Acoustics • Hearing Protection • Moisture & Impact Resistant Products • Floor Impact Noise Reduction
- Sound Absorbers • Noise Barriers • Fabric Wrapped Wall Panels • Acoustical Foam (Egg Crate) • Acoustical Sealants & Adhesives • Outdoor Noise Control • Assistive Listening Devices
- OSHA, FDA, ADA Compliance • On-Site Acoustical Analysis • Acoustical Design & Consulting • Large Inventory • Fast Shipment • No Project too Large or Small • Major Credit Cards Accepted



Acoustical Surfaces, Inc.

SOUNDPROOFING, ACOUSTICS, NOISE & VIBRATION CONTROL SPECIALISTS

123 Columbia Court North • Suite 201 • Chaska, MN 55318

(952) 448-5300 • Fax (952) 448-2613 • (800) 448-0121

Email: sales@acousticalsurfaces.com

Visit our Website: www.acousticalsurfaces.com

We Identify and **S.T.O.P.** Your Noise Problem

INTRODUCTION

This report presents the results of a specimen submitted by the Client, tested at Southwest Research Institute's (SwRI's) Fire Technology Department, located in San Antonio, Texas. The test is conducted in accordance with the procedure outlined in ASTM E 84-06, "Standard Test Method for Surface Burning Characteristics of Building Materials" (NFPA 255, ANSI/UL 723 and UBC 8-1).

This test method is applicable to exposed surfaces, such as ceilings or walls, provided that the material or assembly of materials, by its own structural quality or the manner in which it is tested and intended for use, is capable of supporting itself in position or being supported during the test period. The test is conducted with the material in the ceiling position.

The purpose of this test method is to determine the relative burning behavior of the material by observing the flame spread along the specimen. Flame Spread and Smoke Developed index are reported. However, there is not necessarily a relationship between these two measurements.

This standard should be used to measure and describe the response of materials, products, or assemblies to heat and flame under controlled conditions and should not be used to describe or appraise the fire-hazard or fire-risk of materials, products, or assemblies under actual fire conditions. However, results of the test may be used as elements of a fire-hazard assessment or a fire-risk assessment which takes into account all of the factors which are pertinent to an assessment of the fire hazard or fire risk of a particular end use.

Test specimens are conditioned as appropriate in an atmosphere maintained between 68 and 78°F and 45 to 55% relative humidity. Immediately prior to the test, the specimen is mounted in the furnace with the side to be tested facing the test flame. Cement board is placed on the unexposed side of the specimen to protect the furnace lid assembly. Sometimes, because of the nature of the material undergoing testing, additional support (e.g. wire, wire and rods, rods, and/or bars) is used to ensure that the specimen will remain in position during the test. The use of supporting materials on the underside of the test specimen may lower the Flame Spread Index from that which might be obtained if the specimen could be tested without such support, and the test results do not necessarily relate to indices obtained by testing materials without such support.

The flame front position and light obscuration are recorded throughout the 10-minute test and used to calculate the Flame Spread and Smoke Developed indices. The temperature at 23 ft is also recorded. The Flame Spread and Smoke Developed indices reported herein are relative to the results obtained for mineral fiber-reinforced cement board and select grade red oak (moisture content between 6 and 8%). The mineral fiber-reinforced cement board is the calibration material used to obtain 0 values for Flame Spread and Smoke; red oak decks are used to obtain 100 values for Flame Spread and Smoke.

The results apply specifically to the specimens tested, in the manner tested, and not to the entire production of these or similar materials, nor to the performance when used in combination with other materials.

Two model building codes (2003 International Building Code®, Chapter 8 *Interior Finishes*, Section 803 *Wall and Ceiling Finishes*; NFPA 5000, Chapter 10 *Interior Finish*, Section 10.3 *Interior Wall or Ceiling Finish Testing and Classification*) classify materials based on the Flame Spread and Smoke Developed indices. For reference purposes, the classification criteria are listed below:

Classification	Flame Spread Index	Smoke Developed Index
A	0 – 25	0 – 450
B	26 – 75	0 – 450
C	76 – 200	0 – 450



Acoustical Surfaces, Inc.

SOUNDPROOFING, ACOUSTICS, NOISE & VIBRATION CONTROL SPECIALISTS

123 Columbia Court North • Suite 201 • Chaska, MN 55318

(952) 448-5300 • Fax (952) 448-2613 • (800) 448-0121

Email: sales@acousticalsurfaces.com

Visit our Website: www.acousticalsurfaces.com

We Identify and S.T.O.P. Your Noise Problem

ASTM E 84-06 REPORT

CLIENT: Rendered by Manufacturer and Released to: Acoustical Surfaces, Inc.

SWRI PROJECT NO.: 01.12693.01.032c

TEST DATE: OCTOBER 19, 2006

DAILY TEST NO.: 9

DESCRIPTION OF SPECIMEN

DATE RECEIVED: 13-Oct-2006 (received ready-to-test)

MATERIAL ID:* Bonded Acoustical Cotton Sound Panel

TRADE NAME:* Echo Eliminator 1", 3 lb. White

DESCRIPTION: Cotton acoustical sound panel (3.0 pcf)

THICKNESS: 1.63 in. (nominal)

UNIT WEIGHT: 19.0 lbs per roll

DENSITY:* 3.0 pcf

COLOR: White

SPECIMEN SIZE: One section, 24.0 in. wide x 288.0 in. long

CONDITIONING TIME: 6 days at 70°F and 50% relative humidity

SUPPORT USED:* 2.0-in. hexagonal wire mesh with 0.25-in. diameter steel rods every 24.0 in.

* From Client's material description and/or instructions



Acoustical Surfaces, Inc.

SOUNDPROOFING, ACOUSTICS, NOISE & VIBRATION CONTROL SPECIALISTS

123 Columbia Court North • Suite 201 • Chaska, MN 55318

(952) 448-5300 • Fax (952) 448-2613 • (800) 448-0121

Email: sales@acousticalsurfaces.com

Visit our Website: www.acousticalsurfaces.com

We Identify and S.T.O.P. Your Noise Problem

ASTM E 84-06 REPORT

CLIENT: Rendered by Manufacturer and Released to: Acoustical Surfaces, Inc.

SWRI PROJECT NO.: 01.12693.01.032c

TEST DATE: OCTOBER 19, 2006

DAILY TEST NO.: 9

TEST RESULTS (ROUNDED TO NEAREST 5)

FLAME SPREAD INDEX (FSI):	5
SMOKE DEVELOPED INDEX (SDI):	15

TEST DATA

UNROUNDED FSI:	6.8
UNROUNDED SDI:	16.4
FS*TIME AREA (Ft*Min):	13.3
SMOKE AREA (%*Min):	21.8
FUEL AREA (°F*Min):	4941.2

OBSERVATIONS DURING TEST

IGNITION TIME (Min:Sec):	0:22
MAXIMUM FLAME FRONT ADVANCE (Ft.):	1.4
TIME TO MAXIMUM ADVANCE (Min:Sec):	1:00
MAXIMUM TEMP. AT EXPOSED TC (°F):	569
TIME TO MAXIMUM TEMP. (Min:Sec):	9:39
TOTAL FUEL BURNED (Cu. Ft.):	52.0
DRIPPING (Min:Sec):	None
FLAMING ON FLOOR (Min:Sec):	None
AFTERFLAME TOP (Min:Sec):	None
AFTERFLAME FLOOR (Min:Sec):	None

CALIBRATION DATA (LAST RED OAK)

RED OAK SMOKE AREA (%*Min):	97.1
RED OAK FUEL AREA (°F*Min):	8138.2
GRC BOARD FUEL AREA (°F*Min):	4816.7



Acoustical Surfaces, Inc.

SOUNDPROOFING, ACOUSTICS, NOISE & VIBRATION CONTROL SPECIALISTS

123 Columbia Court North • Suite 201 • Chaska, MN 55318

(952) 448-5300 • Fax (952) 448-2613 • (800) 448-0121

Email: sales@acousticalsurfaces.com

Visit our Website: www.acousticalsurfaces.com

We Identify and S.T.O.P. Your Noise Problem

ASTM E 84-06 REPORT


CLIENT: Rendered by Manufacturer and Released to: Acoustical Surfaces, Inc.

SWRI PROJECT NO.: 01.12693.01.032c

TEST DATE: OCTOBER 19, 2006

DAILY TEST NO.: 9

LIGHT OBSCURATION

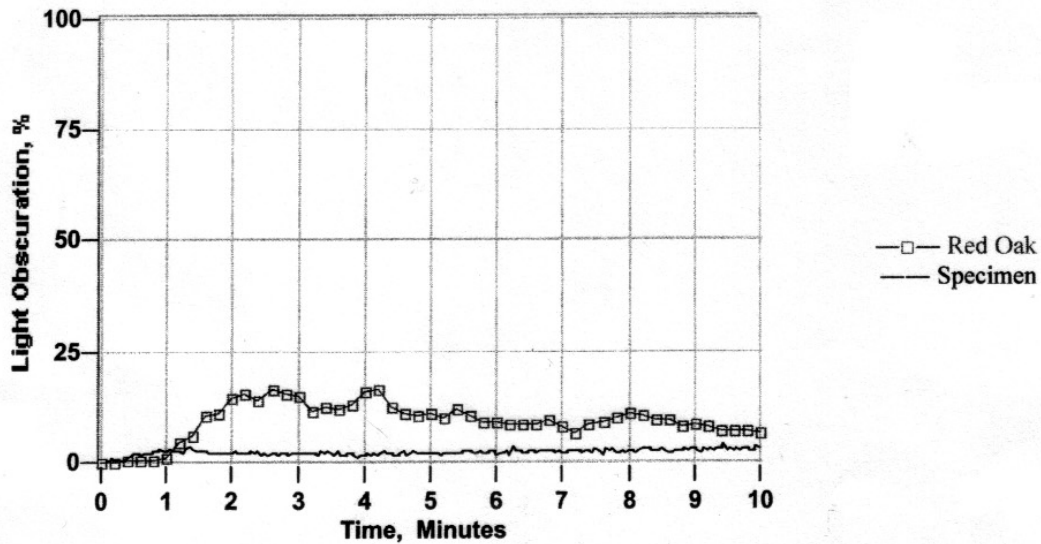

FLAMESPREAD

