



**Title: Sound Absorption Test Results**

**Product: 6 baffles - 2" Echo Eliminator**

Application: Ceiling

Testing Standard: ASTM C423 with baffles suspended on two cables - 16" spacing between baffles  
- 45" spacing between cables


Test Date: 09/26/2000

*Why this test: This test evaluates a products efficiency of absorbing sound at multiple frequencies. The test simulates the product's acoustical performance installed as hanging baffles.*

Test Result Summary: Sabins / Baffle average at NRC frequencies - 13.85

<b>Sabins / Baffle average at NRC frequencies</b>	
<b>13.85</b>	

Frequency (Hz)	Absorption (Sabins/Baffle)
100	3.37
125	2.40
160	2.23
200	5.02
250	6.55
315	8.19
400	10.69
500	12.86
630	15.05
800	16.74
1000	17.46
1250	18.21
1600	18.46
2000	18.49
2500	18.50
3150	18.00
4000	16.77
5000	13.65

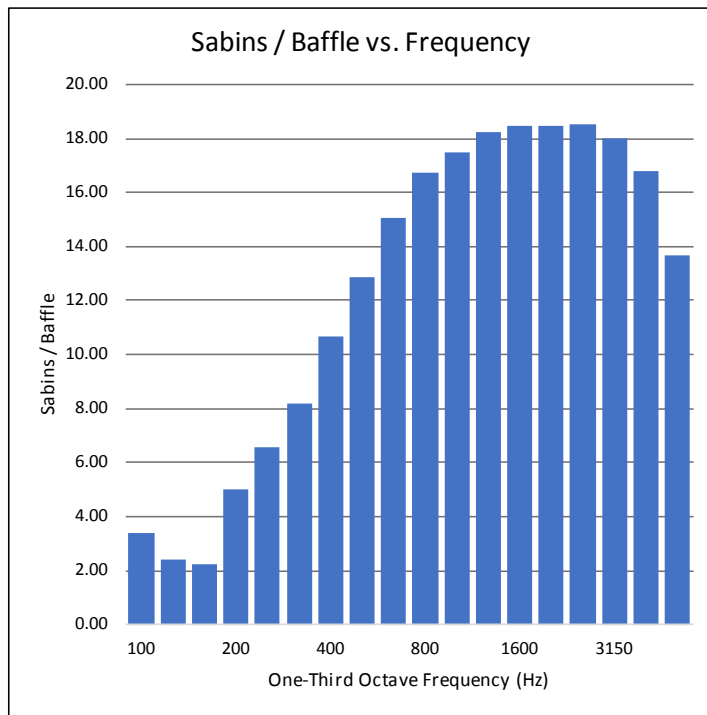

Test ID: 18 0-0730.17

**ASI TEST RESULT DISCLAIMER**

ASI makes every effort to ensure the accuracy and reliability of the information provided. Laboratory testing is conducted by independent testing organizations. ASI does not guarantee that field tests or independent tests will not vary.

© 2018 ASI

PROJECT NUMBER: 18 0-0730.17

PAGE: 1 of 3

DATE: September 26, 2000

STOCK / TWIN CITY TESTING CORPORATION  
662 Cromwell Avenue  
St. Paul, Minnesota 55114

SOUND ABSORPTION TESTING CONDUCTED  
ON SIX BAFFLES CONSISTING OF  
TWO 1" LAYERS BAFF INSULATION

Prepared for:  
ACOUSTICAL SURFACES – DIVISION OF  
ARCHITECTURAL SURFACES, INC.  
Attn: Mr. Steve Anderson  
123 Columbus Court North, Suite 201  
Chaska, MN 55318

Client Purchase Order Number 00012348

Test Conducted By:



Matthew N. Botz  
Project Engineer  
Product Testing Department  
(651) 659-7353

Reviewed By:



Richard O. Thomalla  
Acoustical Services Manager  
Product Testing Department  
(651) 659-7310

The test results contained in this report pertain only to the samples submitted for testing and not necessarily to all similar products.



**PROJECT NUMBER:** 18 0-0730.17

**PAGE:** 2 of 3

**DATE:** September 26, 2000

## **SOUND ABSORPTION - ASTM C423-99a**

### **INTRODUCTION:**

This report presents the results of Sound Absorption testing conducted on six baffles consisting of two 1" thick BAFP insulation submitted by Acoustical Surfaces. This work was requested by Mr. Mike Nixon on September 6, 2000 with the testing conducted on September 13, 2000.

This report must not be reproduced except in its entirety with the approval of Stork / Twin City Testing Corporation. The data in this report relates only to the item tested.

Stork / Twin City Testing Corporation has been accredited by the U.S. Department of Commerce and the National Institute of Standards and Technology (NIST, formerly NBS) under their National Voluntary Laboratory Accreditation Program (NVLAP) for conducting this test procedure. This report may not be used to claim product endorsement by NVLAP or any agency of the U.S. Government.

### **TEST RESULTS SUMMARY:**

The Sabins / Baffle average of the tested specimens was **13.85** at the NRC frequencies of 250, 500, 1000 and 2000 Hertz. A detailed data sheet is provided below under "TEST RESULTS".

### **TEST PROCEDURE:**

ASTM: C423-99a, "Sound Absorption and Sound Absorption Coefficients by the Reverberation Room Method" was followed in every respect. The baffles were suspended above the floor of the reverberation chamber on cables. The full mounting and configuration details are provided under "TEST RESULTS" below.

### **TEST EQUIPMENT:**

<b><u>Manufacturer</u></b>	<b><u>Model</u></b>	<b><u>Serial #</u></b>	<b><u>Description</u></b>
Norwegian Electronics	NE830	11511	Real Time Spectrum Analyzer
Brüel & Kjær	3923	815424	Rotating Microphone Boom
Larson-Davis	2560	1032	Pressure Condenser Microphone
Compaq Computer	V20 CIO	A942CZGZE580	Custom Designed Software

**PROJECT NUMBER:** 18 0-0730.17

**PAGE:** 3 of 3

**DATE:** September 26, 2000

**TEST RESULTS:**

Manufacturer : Acoustical Surfaces  
Type : Baffles 2-1" layers of BAFP insulation comprised each specimen.  
Dimensions (W x H x D) : 2' x 4' x 2"  
Weight : 28 lbs. (0.58 psf)  
Surface Area : 8.0 ft<sup>2</sup>  
Total Surface Area : 96.0 ft<sup>2</sup> – consisting of 6 baffles-(2 sides)  
Mounting Type : 3 specimens suspended on 2 cables. 16" between specimens.  
41" from floor to specimens. 45" between cables.

**Test No. 18 0-0730.17**

<b>Frequency Hz</b>	<b>Absorption Coefficients)</b>
100	3.37
125	2.40
160	2.23
200	5.02
250	6.55
315	8.19
400	10.69
500	12.86
630	15.05
800	16.74
1000	17.46
1250	18.21
1600	18.46
2000	18.49
2500	18.50
3150	18.00
4000	16.77
5000	13.65

**Sabins / Baffle Average (NRC Frequencies) = 13.85**  
The NRC frequencies are at 250, 500, 1000, and 2000 Hz