



Title: Sound Absorption Test Results

Product: 2-1/8" Fabric Wrapped Panel

Application: Wall & Ceiling


Testing Standard: ASTM C423 E-Mount with 1/4" airspace

Test Date: 02/16/2000

Why this test: This test evaluates a products efficiency of absorbing sound at multiple frequencies. The test simulates the product's acoustical performance with a direct installation on a wall or ceiling.

Test Result Summary: NRC - 1.05

NRC	
1.05	
Frequency (Hz)	Absorption Coefficient
125	0.46
250	0.85
500	1.16
1000	1.16
2000	1.12
4000	1.09

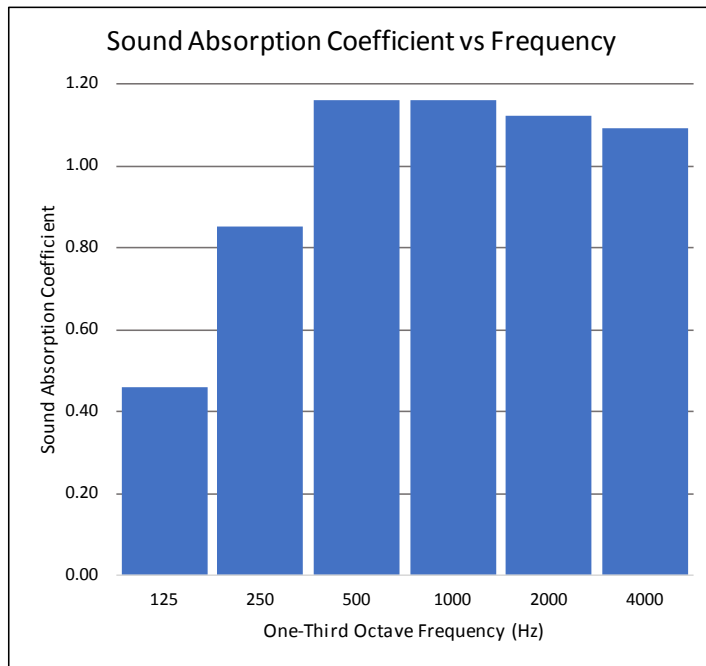

Test ID: 18 0-0088

ASI TEST RESULT DISCLAIMER

ASI makes every effort to ensure the accuracy and reliability of the information provided. Laboratory testing is conducted by independent testing organizations. ASI does not guarantee that field tests or independent tests will not vary.

© 2018 ASI

PROJECT NUMBER: 18 0-0088

PAGE: 1 of 2

DATE: Feb. 16, 2000

SOUND ABSORPTION - ASTM C423-90a

INTRODUCTION:

This report presents the results of a Noise Reduction Coefficient (NRC) test conducted on High Impact Acoustical Wall Panels submitted on February 4, 2000 with the testing completed on February 15, 2000.

This report must not be reproduced except in its entirety with the approval of Stork / Twin City Testing Corporation. The data in this report relates only to the item tested.

Stock / Twin City Testing Corporation has been accredited by the U.S. Department of Commerce and the National Institute of Standards and Technology (NIST, formerly NBS) under their National Voluntary Laboratory Accreditation Program (NVLAP) for conducting this test procedure. This report may not be used to claim product endorsement by NVLAP or any agency of the U.S. Government

TEST METHOD:

ASTM C 423-90a, "Sound Absorption and Sound Absorption Coefficients by th Reverberation Room Method" was followed in every respect.

Absorption coefficients are the fraction of diffuse incident sound absorbed by the specimen and are expressed in sabins per square foot. The NRC is the average of the absorption coefficients for 250, 500, 1000, and 2000 Hertz and is reported to the nearest integral of 0.05.

The temperature and relative humidity of the chamber during the tests were 72°F and 52%, respectively.

TEST EQUIPMENT:

<u>Manufacturer</u>	<u>Model</u>	<u>Serial #</u>	<u>Description</u>
Norwegian Electronics	NE830	11511	Real Time Spectrum Analyzer
Brüel & Kjær	3923	815424	Rotating Microphone Boom
Larson-Davis	2560	1032	Pressure Condenser Microphone

PROJECT NUMBER: 18 0-0088

PAGE: 1 of 2

DATE: Feb. 16, 2000

SPECIMEN IDENTIFICATION TEST TWO:

Manufacturer : Rendered by Manufacturer for Acoustical Surfaces Inc.
Type : High Impact Acoustical Wall Panel
Nom Dimensions (W x H x D) : 4' x 8' x 2-1/8"
Weight : 41.0 lbs. (1.78 psf)
Surface Area : 32.0 ft².
Total Surface Area Tested : 64 ft². – consisting of 2 specimens.
Mounting Type : Type E – 1/4" air space off floor.
Specimen Description : 1/8". 16-20 PCF fiberglass impact layer bonded to 2" 6.0 PCF fiberglass core, 100% polyester fabric facing.

2-1/8"
RESULTS – TEST TWO:

Frequency Hz	Abs. Coefficients	Uncertainty %
125	0.46	4.6
250	0.85	3.4
500	1.16	1.9
1000	1.16	1.5
2000	1.12	1.1
4000	1.09	0.9

Noise Reduction Coefficient (NRC) = 1.05

Freq. = Octave band center frequency.
Abs. Coefficient = Sound absorption coefficient (extended plane applications)
Uncertainty = % uncertainty of the absorption coefficient for 95% confidence